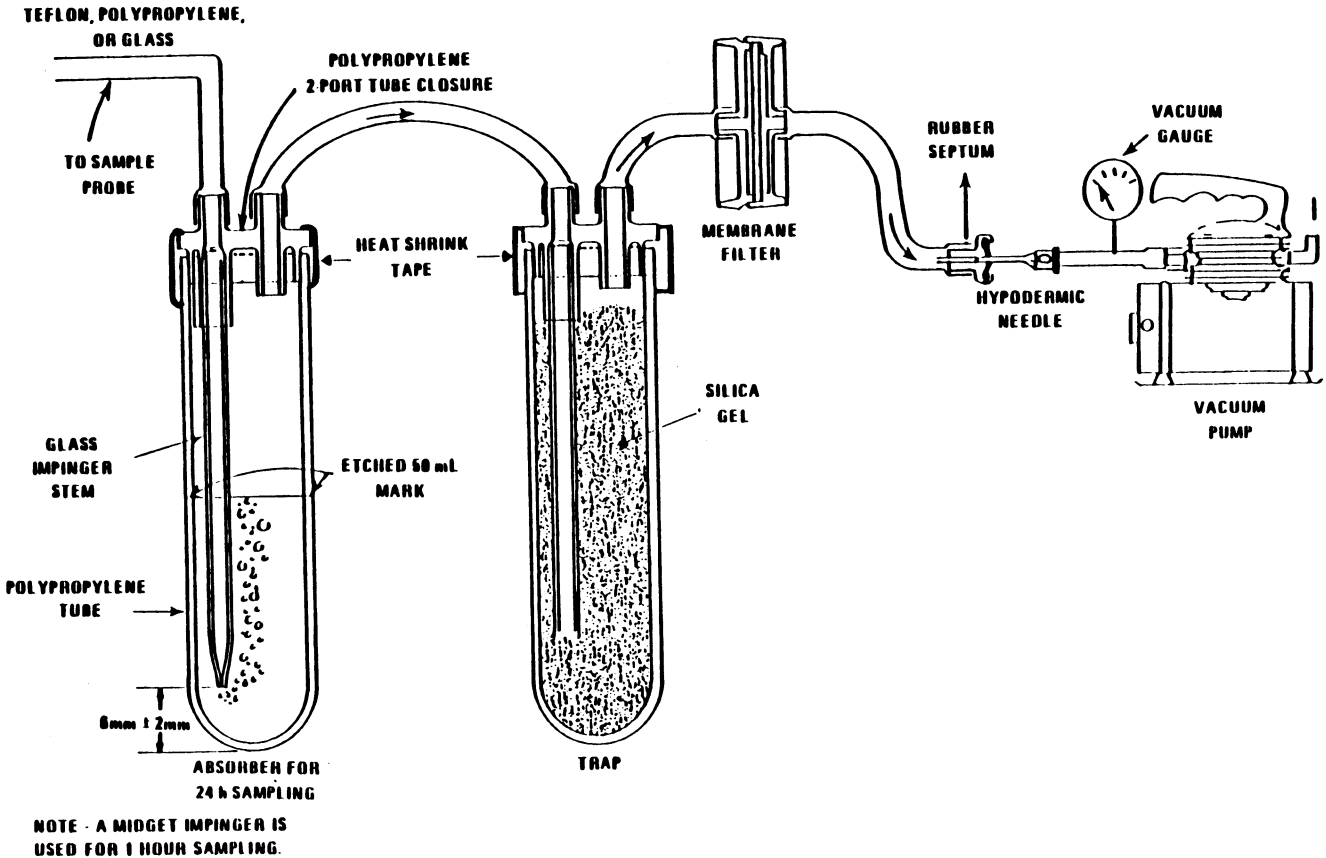

Figure 2. 24-Hour sampling system.